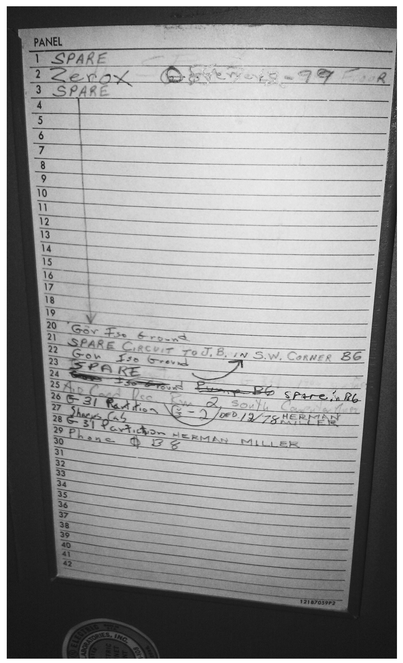

1 EXISTING PANELBOARD LP-020A
NTS

LP-020A NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

2. ENSURE CIRCUITS 20, 22, 25 REMAIN OPTIONAL DURING DEMOLITION.

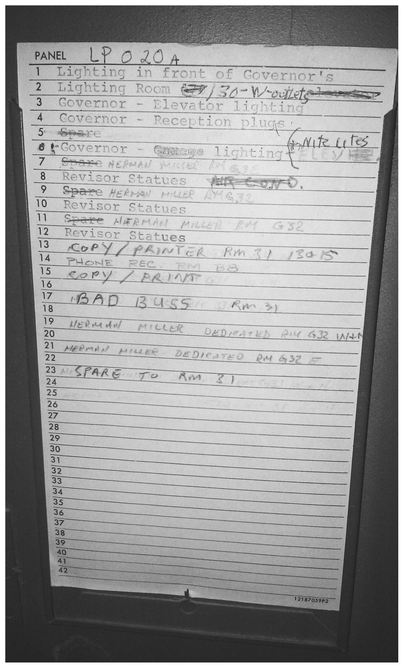

2 EXISTING PANELBOARD LP-020B
NTS

LP-020B NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

2.ENSURE CIRCUITS 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 17, 19, 24 REMAIN OPTIONAL DURING DEMOLITION.

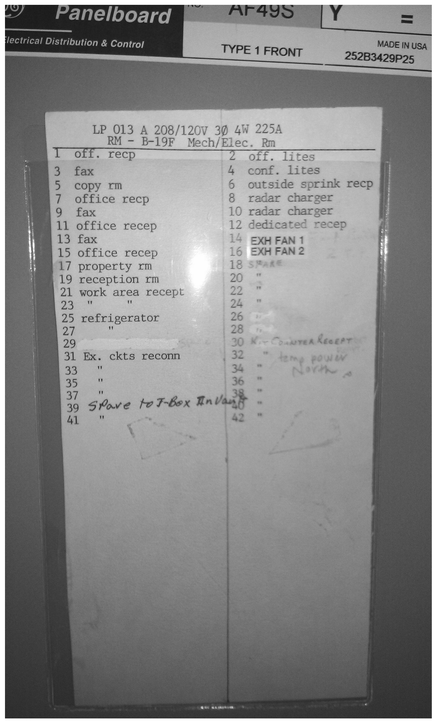

3 EXISTING PANELBOARD LP-013A
NTS

LP-013A NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

2. ENSURE CIRCUITS 6, 30 REMAIN OPTIONAL DURING DEMOLITION.

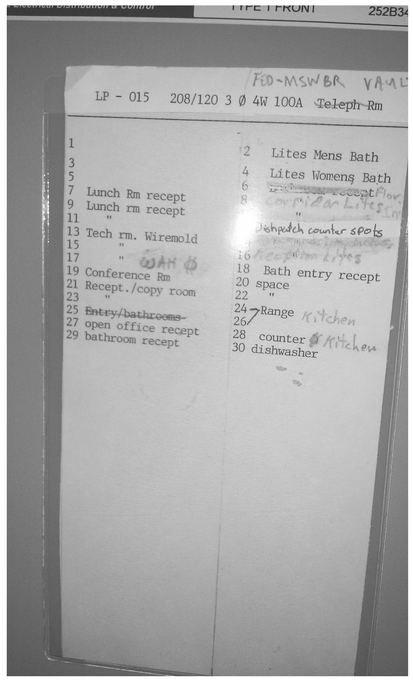

4 EXISTING PANELBOARD LP-015
NTS

LP-015 NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

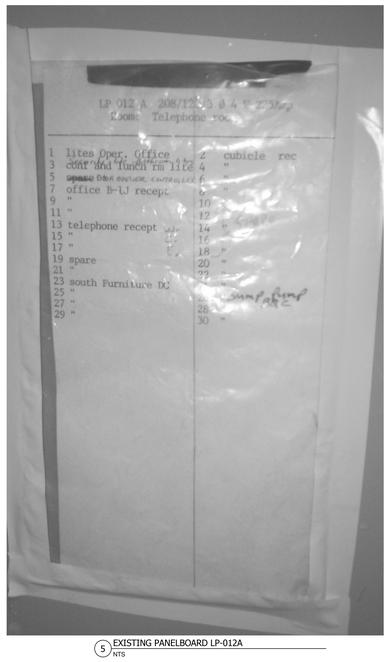

5 EXISTING PANELBOARD LP-012A
NTS

LP-012A NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

2. ENSURE CIRCUIT 26 REMAINS OPTIONAL DURING DEMOLITION.

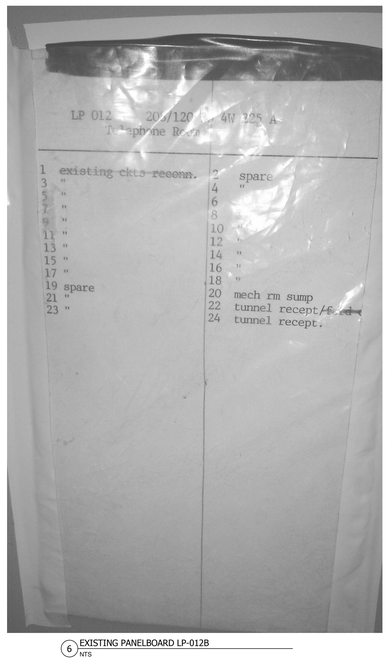

6 EXISTING PANELBOARD LP-012B
NTS

LP-012B NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL.

2. ENSURE CIRCUITS 20, 22, 24 REMAIN OPTIONAL DURING DEMOLITION.

7 EXISTING PANELBOARD EM-2
NTS

EM-2 NOTES
1. PANELBOARD SHALL BE DEMOLISHED AS LONG AS CIRCUITS SERVING OCCUPIED AREAS OF THE BUILDING REMAIN OPERATIONAL. PROVIDE TEMPORARY POWER AS REQUIRED TO ENSURE OCCUPPIED AREAS MAINTAIN EMERGENCY POWER.

2. ENSURE CIRCUITS 2, 4 REMAIN OPTIONAL DURING DEMOLITION.

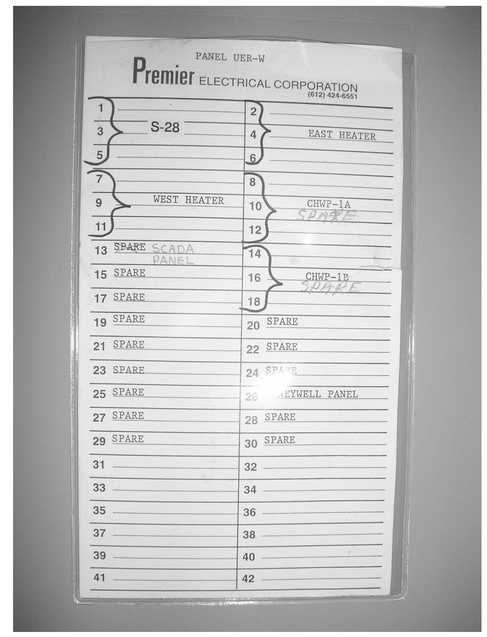
PANEL UER-W
Premier ELECTRICAL CORPORATION
(612) 424-6551
S-28
EAST HEATER
WEST HEATER
CHWP-1A
SPARE
SPARE SCADA PANEL
CHWP-1B
SPARE
SPARE
SPARE