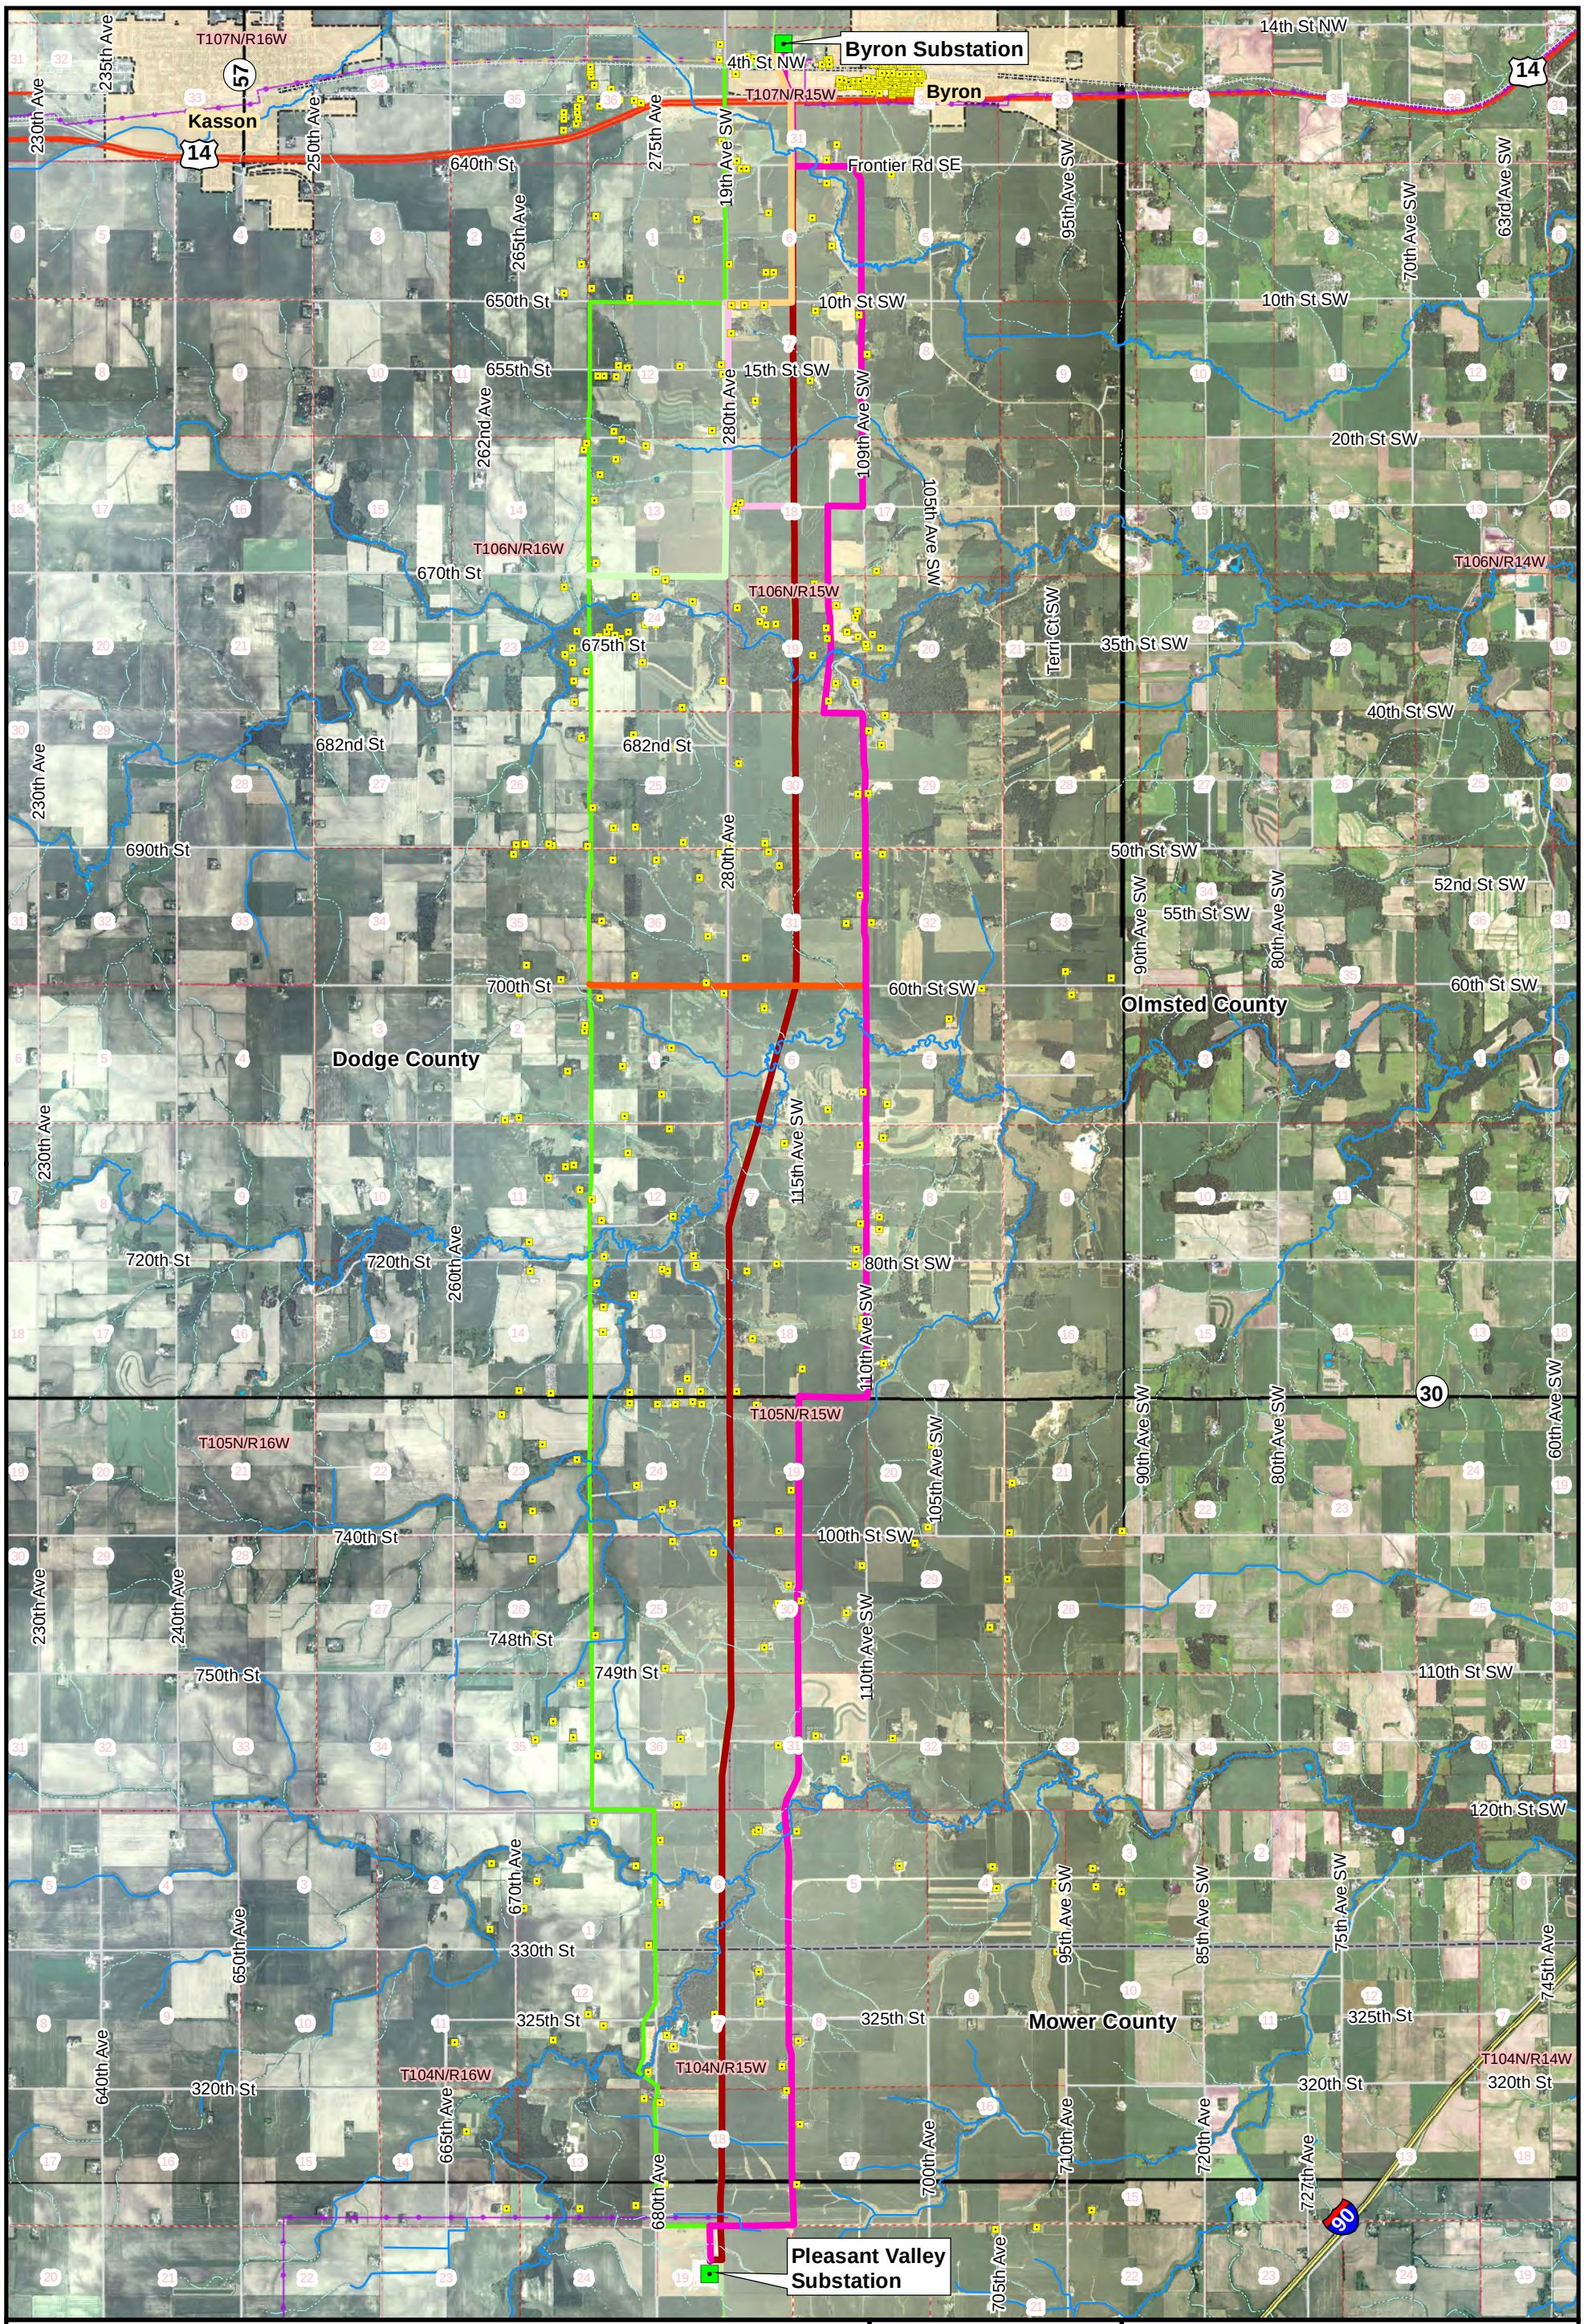

Residential Dwelling
Substation
River/Stream
Intermittent Stream/Drain
Interstate Highway
U.S.Highway
State Highway
County Road

County Boundary
PLS Township
PLSS Section
Incorporated Area

Existing Transmission Line

Existing 69 kV
Existing 161 kV
Existing 345 kV

Crossover Segment
Route Alternative 1
Route Alternative 2
Route Alternative 3
Segment Alternative A
Segment Alternative B
Segment Alternative C

N

0 0.25 0.5 1 Miles

ERM

Figure 1
Route Alternative Overview Map

Pleasant Valley to Byron Transmission Line
Xcel Energy
November 2010